


Figure 5-23. Termination of Grounds and Neutrals in Subpanel

Subpanels

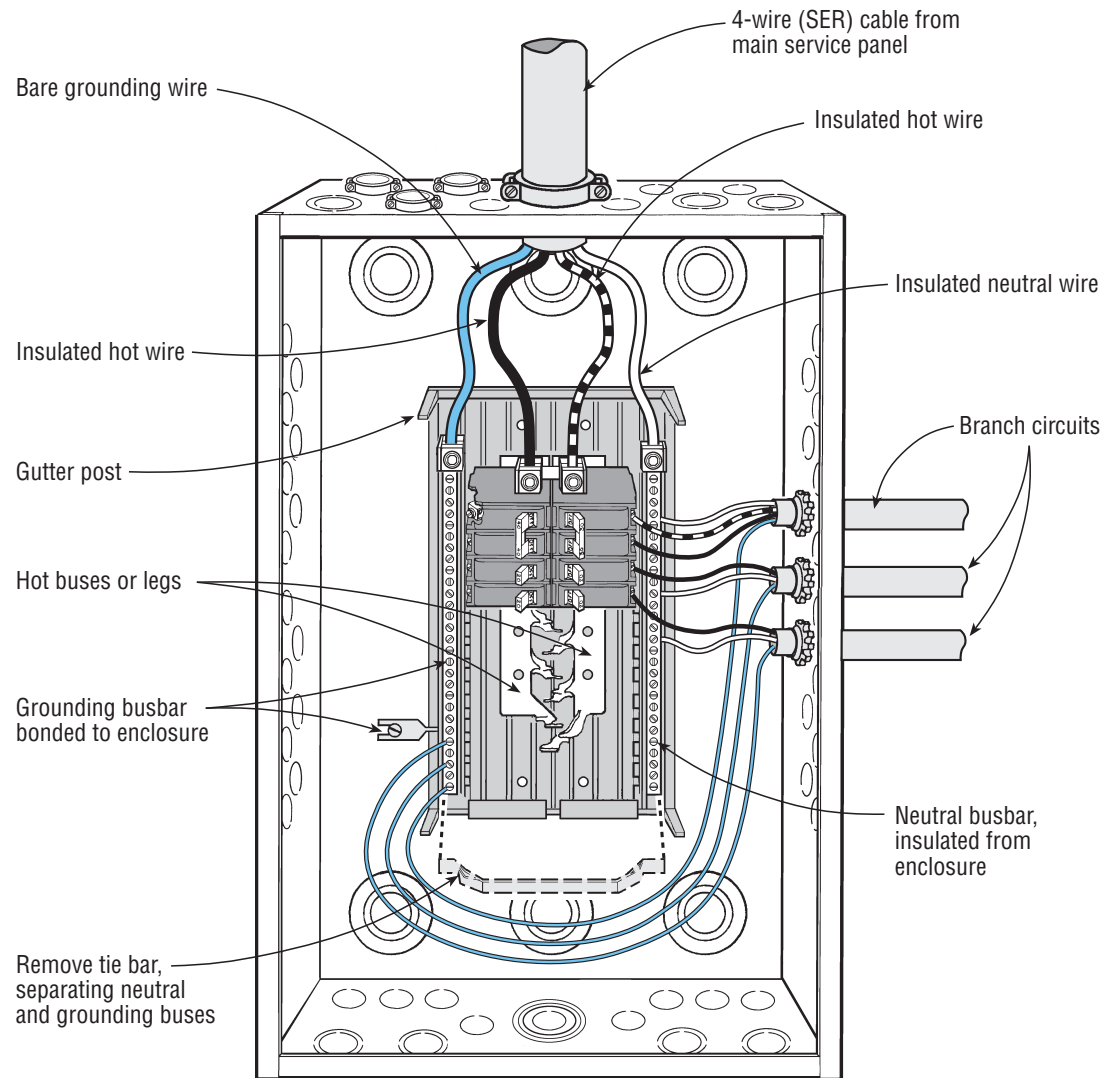

In a subpanel, neutrals and ground wires are kept separate and are terminated into separate bars. Only the ground bar is bonded to the panel's enclosure.